

SILVER STREAK® PIPING SYSTEMS



NOV Fiber Glass Systems is the combination of the **Star®** **Fiberglass** product line and the **Smith Fibercast®** product lines bringing over 60 years of “Time-Tested” composite pipe experience to the Oilfield, Chemical/Industrial, Petroleum Marketing, Marine and Offshore markets.

PRODUCT

Available in **2” through 24”** diameters, **Silver Streak** piping is designed especially for abrasive and corrosive services found in flue gas desulfurization (FGD) scrubber applications such as limestone, gypsum and ammonium sulfate slurries.

Silver Streak pipe is filament wound using epoxy resin and fiberglass reinforcement. Manufactured with a proprietary blend of abrasion-resistant additives, it is offered with a standard 80 mil nominal liner. Custom liner thicknesses are available on special request.

Silver Streak epoxy piping up to 24” diameters is ideal for yard piping and is designed to operate at temperatures up to 225°F and pressures up to 225 psig. **Silver Streak LD**, available in **30” through 48”** diameters, is ideal for recirculating piping and operates at temperatures up to 200°F and pressures up to 150 psig.

FITTINGS

A complete line of standard fittings, including long radius elbows, are available. Fittings are constructed with the same abrasion-resistant additives as the pipe. All fittings, except compression molded, have a minimum corrosion/abrasion barrier of 100 mils.

- Fittings Literature:
A2050-Standard 2”-24”

JOINING METHODS

The standard joining system for **Silver Streak** piping is the **matched tapered bell and spigot**. Epoxy adhesive is used to secure the joint. When properly installed, the entire system will operate at the maximum pressure rating of the pipe.

FIELD TAPERING & JOINING

Silver Streak pipe can be cut and tapered in the field using NOV Fiber Glass Systems tapering tools. For detailed information, refer to **Manual No. F6000, Pipe Installation Handbook for Matched Tapered Bell & Spigot Joints**, and to individual tool and adhesive sheets for **Silver Streak** products.


BENEFITS

There are many advantages to choosing **Silver Streak** pipe:

- Entire 80 mil nominal liner contains 80 percent resin/abrasion-resistant additives and 20% reinforcement.
- Designed to operate at temperatures up to 225°F and pressures up to 225 psig.
- Rated for full vacuum service at 175°F.
- Complete line of standard fittings, including long radius elbows, available—constructed with the same abrasion-resistant additives as the pipe.
- Pipe comes spigot x spigot in 2” through 12” sizes and spigot x spigot or bell x spigot in 14” through 24” sizes.
- Custom-fabricated assemblies are available upon request.

DISTRIBUTION

NOV Fiber Glass Systems has a network of stocking distributors across the U.S. as well as representatives and distributors in many other parts of the world. These distributors are supported by a staff of experienced technical personnel at the home office and by highly trained, strategically located field personnel.

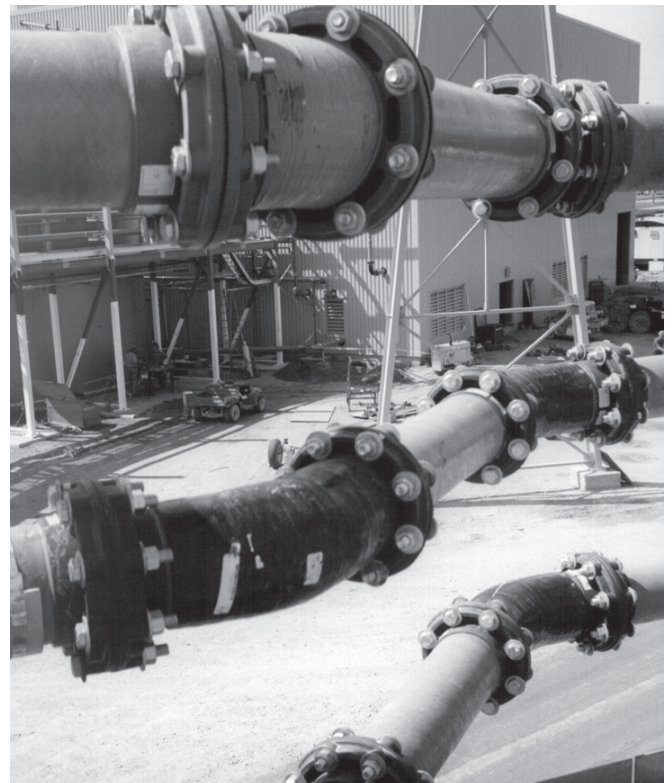

PRODUCT DATA

Nominal Dimensional Data (Liner Thickness = 0.080"/1.8 mm)

Pipe Size (In)	I.D.		O.D.		Wall Thickness		Weight		Capacity	
	(In)	(mm)	(In)	(mm)	(In)	(mm)	(Lbs/Ft)	(kg/m)	(Gal/Ft)	(Ft ³ /Ft)
2	2.00	51	2.40	61	0.200	5.1	1.1	1.6	0.16	0.022
3	3.28	83	3.65	93	0.186	4.7	1.6	2.4	0.44	0.059
4	4.28	109	4.66	118	0.190	4.8	2.1	3.1	0.75	0.100
6	6.35	161	6.75	171	0.197	5.0	3.1	4.6	1.65	0.220
8	8.36	212	8.83	224	0.233	5.9	5.0	7.4	2.85	0.381
10	10.36	263	10.87	276	0.251	6.4	6.6	9.8	4.38	0.585
12	12.29	312	12.81	325	0.260	6.6	8.1	12.1	6.16	0.824
14	14.04	357	14.71	374	0.338	8.6	12.3	18.3	8.04	1.075
16	16.04	407	16.68	424	0.320	8.1	13.2	19.6	10.5	1.403
18	17.83	453	18.50	470	0.336	8.5	15.5	23.1	12.97	1.734
20	19.83	504	20.56	522	0.364	9.2	18.7	27.8	16.04	2.145
24	23.83	605	24.66	626	0.414	10.5	25.7	38.3	23.17	3.097

Tolerances or maximum/minimum limits can be obtained from NOV Fiber Glass Systems.

ASTM D2996 Designation Codes:

2"-24"

RTRP-11FY1-3110

Pipe Lengths Available

Size (In)	Random Length (Ft)
2-6	20
8-24	40



Pressure Ratings

Size (In)	Maximum Internal Static Pressure (psig) 225°F	Maximum External Static Pressure (psig) 175°F
2-24	225	Full Vacuum

Average Physical Properties

Property	75°F psi	24°C MPa	225°F psi	107°C MPa
Axial Tensile - ASTM D2105				
Ultimate Stress	10,550	72.7	7,160	49.4
Modulus of Elasticity	1.75 x 10 ⁶	12,093	1.03 x 10 ⁶	7,102
Poisson's Ratio $V_{a/h}$ ($V_{h/a}$)				
0.35 (0.56)				
Axial Compression - ASTM D694				
Ultimate Stress	33,300	229.6	17,800	122.7
Modulus of Elasticity	1.26 x 10 ⁶	8,687	0.54 x 10 ⁶	3,723
Beam Bending - ASTM D2925				
Ultimate Stress	23,000	158.6	16,000	110.3
Modulus of Elasticity (Long Term)	2.18 x 10 ⁶	15,030	1.10 x 10 ⁶	7,653
Hydrostatic Burst - ASTM D1599				
Ultimate Hoop Tensile Stress	46,300	319	49,500	341.3
Ring Tensile - ASTM D2990				
Minimum Hoop Tensile Stress	27,280	188	-	-
Hydrostatic Design - ASTM D2992, Procedure B - Hoop Tensile Stress				
(LTHS)	27,715	191	16,945*	116.8*
20 Year Static Life at 200°F/93.3°C (LCL)	22,400	154	14,654	101.0*

Thermal Expansion Coefficient - ASTM D696	1.26 x 10 ⁻⁵ in/in/°F	1.58 x 10 ⁻⁵ mm/mm/°C
Thermal Conductivity	0.23 BTU/hr-ft-°F	0.4 W/m-°C
Specific Gravity - ASTM D792	1.8	
Absolute Surface Roughness	0.00021 Inch	0.0053 mm
Manning Roughness Coefficient, n	0.009	

Properties of Pipe Sections Based on Minimum Reinforced Wall

Size (In)	Reinforcement End Area (In ²)	Reinforcement Moment of Inertia (In ⁴)	Reinforcement Section Modulus (In ³)	Nominal Wall End Area (In ²)
2	0.74	0.48	0.40	1.38
3	1.03	1.61	0.88	2.03
4	1.37	3.52	1.51	2.67
6	2.13	11.6	3.45	4.05
8	3.64	34.1	7.72	6.29
10	5.02	71.4	13.1	8.37
12	6.24	124	19.3	10.3
14	10.2	266	36.2	15.3
16	10.8	364	43.7	16.4
18	12.8	531	57.5	19.2
20	15.8	808	78.6	23.0
24	22.3	1,641	133	31.5

Recommended Operating Ratings

Size (In)	Axial Tensile Loads Max. (Lbs)		Axial Compressive Loads Max. (Lbs) ⁽¹⁾		Bending Radius Min. (Ft) Entire Temp. Range	Torque Max. (Ft Lbs) Entire Temp. Range	Parallel Plate Loading ASTM D2412		
	Temperature		Temperature				Stiffness Factor (In ³ /Lbs/In ²)	Pipe Stiffness (psi)	Hoop Modulus x10 ⁶ (psi)
	75°F	225°F	75°F	225°F					
2	1,900	1,300	6,600	3,000	75	130	n/a	n/a	n/a
3	2,700	1,800	8,500	4,000	110	280	n/a	n/a	n/a
4	3,600	2,400	11,000	6,000	140	480	n/a	n/a	n/a
6	5,600	3,800	17,000	9,000	210	1,100	n/a	n/a	n/a
8	9,500	6,500	30,000	16,000	270	2,480	n/a	n/a	n/a
10	13,000	8,900	41,000	22,000	340	4,200	n/a	n/a	n/a
12	16,000	11,000	51,000	27,000	400	6,200	n/a	n/a	n/a
14	26,000	18,000	85,000	45,000	460	11,000	n/a	n/a	n/a
16	28,000	19,000	90,000	48,000	520	14,000	n/a	n/a	n/a
18	33,000	22,000	100,000	56,000	580	18,000	n/a	n/a	n/a
20	41,000	28,000	130,000	70,000	640	25,000	n/a	n/a	n/a
24	58,000	39,000	180,000	99,000	770	42,000	n/a	n/a	n/a

⁽¹⁾Compressive loads are for short columns only.

SUPPORTS

Proper pipe support spacing depends on the temperature and weight of the fluid in the pipe. The support spacing table is based on unrestrained continuous beam theory using the pipe bending modulus derived from long-term beam bending tests. The maximum spans lengths were developed to ensure a design that limits mid-span deflection to 1/2 inch and dead weight bending to 1/8 of the ultimate bending stress. Any additional loads on the piping system such as insulation, wind, seismic, etc. requires further consideration. Restrained (anchored) piping systems operating at elevated temperatures may result in guide spacing requirements that are shorter than unrestrained piping systems. In this case, the maximum guide spacing governs the support span requirements for the system. Pipe spans near elbows require special attention. Both supported and unsupported elbows are considered in the following tables and must be followed to properly design the piping system.

There are seven basic rules to follow when designing piping system supports:

1. Do not exceed the recommended support span.
2. Support heavy valves and in-line equipment independently.
3. Protect pipe from external abrasion at supports.
4. Avoid point contact loads.
5. Avoid excessive bending. This applies to handling, transporting, initial layout, and final installed position.

6. Avoid excessive vertical loading to minimize bending stresses on pipe and fittings.
7. Provide adequate axial and lateral restraint to ensure line stability during rapid changes in flow.

Maximum Support Spacing for Uninsulated Pipe⁽¹⁾

Pipe Size (In.)	Continuous Spans of Pipe (Ft.) ⁽²⁾		
	75°F	150°F	225°F
2	14.7	13.7	12.4
3	16.5	15.4	13.9
4	17.9	16.7	15.1
6	20.2	18.9	17.1
8	23.2	21.6	19.6
10	25.2	23.5	21.3
12	26.7	24.9	22.5
14	30.0	28.0	25.4
16	30.6	28.6	25.9
18	32.0	29.8	27.0
20	33.7	31.4	28.4
24	36.7	34.3	31.0

⁽¹⁾Consult factory for insulated pipe support spacing.

⁽²⁾Maximum mid-span deflection 1/2" with a specific gravity of 1.0.

Support Spacing vs. Specific Gravity

Specific Gravity	2.00	1.50	1.25	1.00	0.75
Multiplier	0.87	0.92	0.96	1.00	1.05

Example: 6" pipe @ 150°F with 1.5 specific gravity fluid, maximum support spacing = 18.9 x 0.92 = 17.4 ft.

Adjustment Factors for Various Spans With Unsupported Fitting at Change in Direction

	Span Type	Factor
a	Continuous interior or fixed end spans	1.00
b	Second span from supported end or unsupported fitting	0.80
c+d	Sum of unsupported spans at fitting	≤0.75*
e	Simple supported end span	0.67

*For example: If continuous support is 10 ft., c+d must not exceed 7.5 ft. (c=3 ft. and d=4.5 ft.) would satisfy this condition.

Adjustment Factors for Various Spans With Supported Fitting at Change in Direction

	Span Type	Factor
a	Continuous interior or fixed end spans	1.00
b	Second span from simple supported end or unsupported fitting	0.80
e	Simple supported end span	0.67

THERMAL EXPANSION

The effects of thermal gradients on piping systems may be significant and should be considered in every piping system flexibility analysis. Pipe line movements due to thermal expansion or contraction may cause high stresses or even buckle a pipe line if improperly restrained. Several piping system designs are used to manage thermal expansion and contraction in above ground piping systems. They are listed below according to economic preference:

1. Using directional changes inherent flexibility
2. Restrain pipe axially and guide supports to control deflections and buckling
3. Use expansion loops to absorb thermal movements
4. Use mechanical expansion joints to absorb thermal movements

To perform a thermal analysis the following information is required:

1. An isometric layout of piping system
2. Physical geometry and material properties of pipe
3. Design temperatures

4. Installation temperature (Final tie in temperature)
5. Terminal equipment load limits
6. Support movements

A comprehensive review of temperature effects on fiberglass pipe may be found in NOV Fiber Glass Systems' "Engineering and Piping Design Guide", Manual No. E5000, Section 3.

Change in Temperature °F	Pipe Change in Length (In/100 Ft)
25	0.38
50	0.76
75	1.13
100	1.51

Restrained Thermal End Loads and Guide Spacing

Operating Temperature °F (Based on installation temperature of 75°F)								
Size (In)	125°F		150°F		175°F		200°F	
	Guide Spacing (Ft)	Thermal End Load (Lbs)	Guide Spacing (Ft)	Thermal End Load (Lbs)	Guide Spacing (Ft)	Thermal End Load (Lbs)	Guide Spacing (Ft)	Thermal End Load (Lbs)
2	11.1	481	9.2	637	8.1	736	7.4	778
3	17.4	661	14.4	875	12.7	1,011	11.5	1,069
4	22.4	877	18.5	1,161	16.2	1,342	14.8	1,419
6	32.7	1,366	27.0	1,809	23.7	2,090	21.6	2,211
8	42.7	2,339	35.3	3,095	31.0	3,577	28.2	3,783
10	52.7	3,225	43.5	4,269	38.2	4,933	34.8	5,218
12	62.2	4,009	51.4	5,307	45.1	6,132	41.1	6,486
14	71.2	6,573	58.8	8,700	51.7	10,054	47.1	10,364
16	81.0	6,959	66.9	9,210	58.8	10,643	53.5	11,257
18	90.0	8,225	74.3	10,886	65.3	12,579	59.5	13,305
20	99.8	10,153	82.5	13,437	72.4	15,528	66.0	16,424
24	119.8	14,329	98.9	18,966	86.9	21,916	79.1	23,180

Note: If guide spacing exceeds support span length then guide at each supports.

OTHER CONSIDERATIONS

Testing:

Hydrostatic testing should be performed to evaluate the structural integrity of a new piping system installation. Test pressures of 1.5 times the design pressure but not exceeding 1.5 times the static pressure rating of the lowest rated fiberglass component in the piping system is recommended. The hydrotest pressure should be repeated up to ten times to provide a high degree of confidence in the piping system. The final pressurization should be allowed to stabilize for 15-30 minutes, then, inspected for leaks. Do not attempt to repair leaks while system is pressurized. The hydro test should be repeated after any re-work is performed.

When hydro testing open vents to prevent entrapment of air in the lines as the system is slowly filled with water. Then close the vents and slowly pressurize to the test pressure. Upon completion of hydro test, relieve the pressure on the system slowly, open vents and any drains to allow for complete drainage of the system.

Piping systems with design temperatures above 150°F should be tested at 1.5 times the static pressure rating of the lowest rated fiberglass component in the system.

Water Hammer:

Care should be taken when designing a fiberglass piping system to eliminate sudden surges. Soft start pumps and slow actuating valves should be considered.

APPROVALS



SALES OFFICES

North America

2700 West 65th Street
Little Rock, AR 72209
Phone: 501 568 4010
Fax: 501 568 4465

25 S. Main Street
Sand Springs, OK 74063
Phone: 918 245 6651
Fax: 918-245 7566

Canada

30 Strathlea Crescent SW
Calgary, Alberta Canada T3H 5A8
Phone: 403 660 4131
Fax: 403 246 7850

Latin America (North Zone)

2425 SW 36th Street
San Antonio, Texas 78237
Phone: 210 896 4438
Fax: 210 434 7543

Latin America (Mercosul)

Fernando Simoes Barbosa #266
Oficina 1304
Boa Viagem
Recife, Pernambuco
Brazil 51020-390
Phone: 55 81 81312488

Central Asia / Russia

Microdistrict-13, Bldg-23, Apt. 4
Mangistau Region
Aktau, Kazakhstan
Phone: 7 701 5141087
Fax: 7 7292 436176

Middle East

PO Box 61335
Jafza View 18, Office 0506
Jebel Ali Free Zone
Dubai, United Arab Emirates
Phone: 9714 886 5660
Fax: 9714 886 5670

Pacific Rim

10 Ubi Crescent
#02-93 Ubi Techpark (Lobby E)
Singapore 408564
Phone: 65 6842 2293
Fax: 65 6741 2293

China

6 Ning Bo Road, Haping Road
Centralized, Industrial Park,
Harbin Development Zone
Harbin China 150060
Phone: 86 451 8709 1718
Fax: 86 451 8709 1719

Litanghe Road
Xiangcheng Economic Development
Zone
Suzhou, China 215131
Phone: 86 512 8518 0099
Fax: 86 512 8512 0101

Europe

Dlha 27
Nesvady 94651
Slovakia
Phone: 42 191 836 0122

West Africa

P.O. Box 14148
Chioma Loveday Flats,
Chief Ogbonda's Compound, #105
Woji Road
Woji, Port Harcourt, RV 500001
Nigeria
Phone: 234 803 338 2623
Fax: 215 252 5140

MANUFACTURING FACILITIES

San Antonio, Texas USA
Big Spring, Texas USA
Wichita, Kansas USA
Little Rock, Arkansas USA
Sand Springs, Oklahoma USA
Harbin, China
Suzhou, China

Downhole Solutions

Drilling Solutions

Engineering and Project Management Solutions

Lifting and Handling Solutions

Production Solutions

Supply Chain Solutions

Tubular and Corrosion Control Solutions

Well Service and Completion Solutions

Headquarters

2425 SW 36th Street
San Antonio, Texas 78237 USA
Phone: 210 434 5043
Fax: 210 434 7543

National Oilwell Varco has produced this brochure for general information only, and it is not intended for design purposes. Although every effort has been made to maintain the accuracy and reliability of its contents, National Oilwell Varco in no way assumes responsibility for liability for any loss, damage or injury resulting from the use of information and data herein. All applications for the material described are at the user's risk and are the user's responsibility. All brands listed are trademarks of National Oilwell Varco.

NOV Fiber Glass Systems

One Company . . . Unlimited Solutions

fgspipe@nov.com

www.fgspipe.com

© 2010 National Oilwell Varco
® Trademark of National Oilwell Varco
A2000 - March 2010